
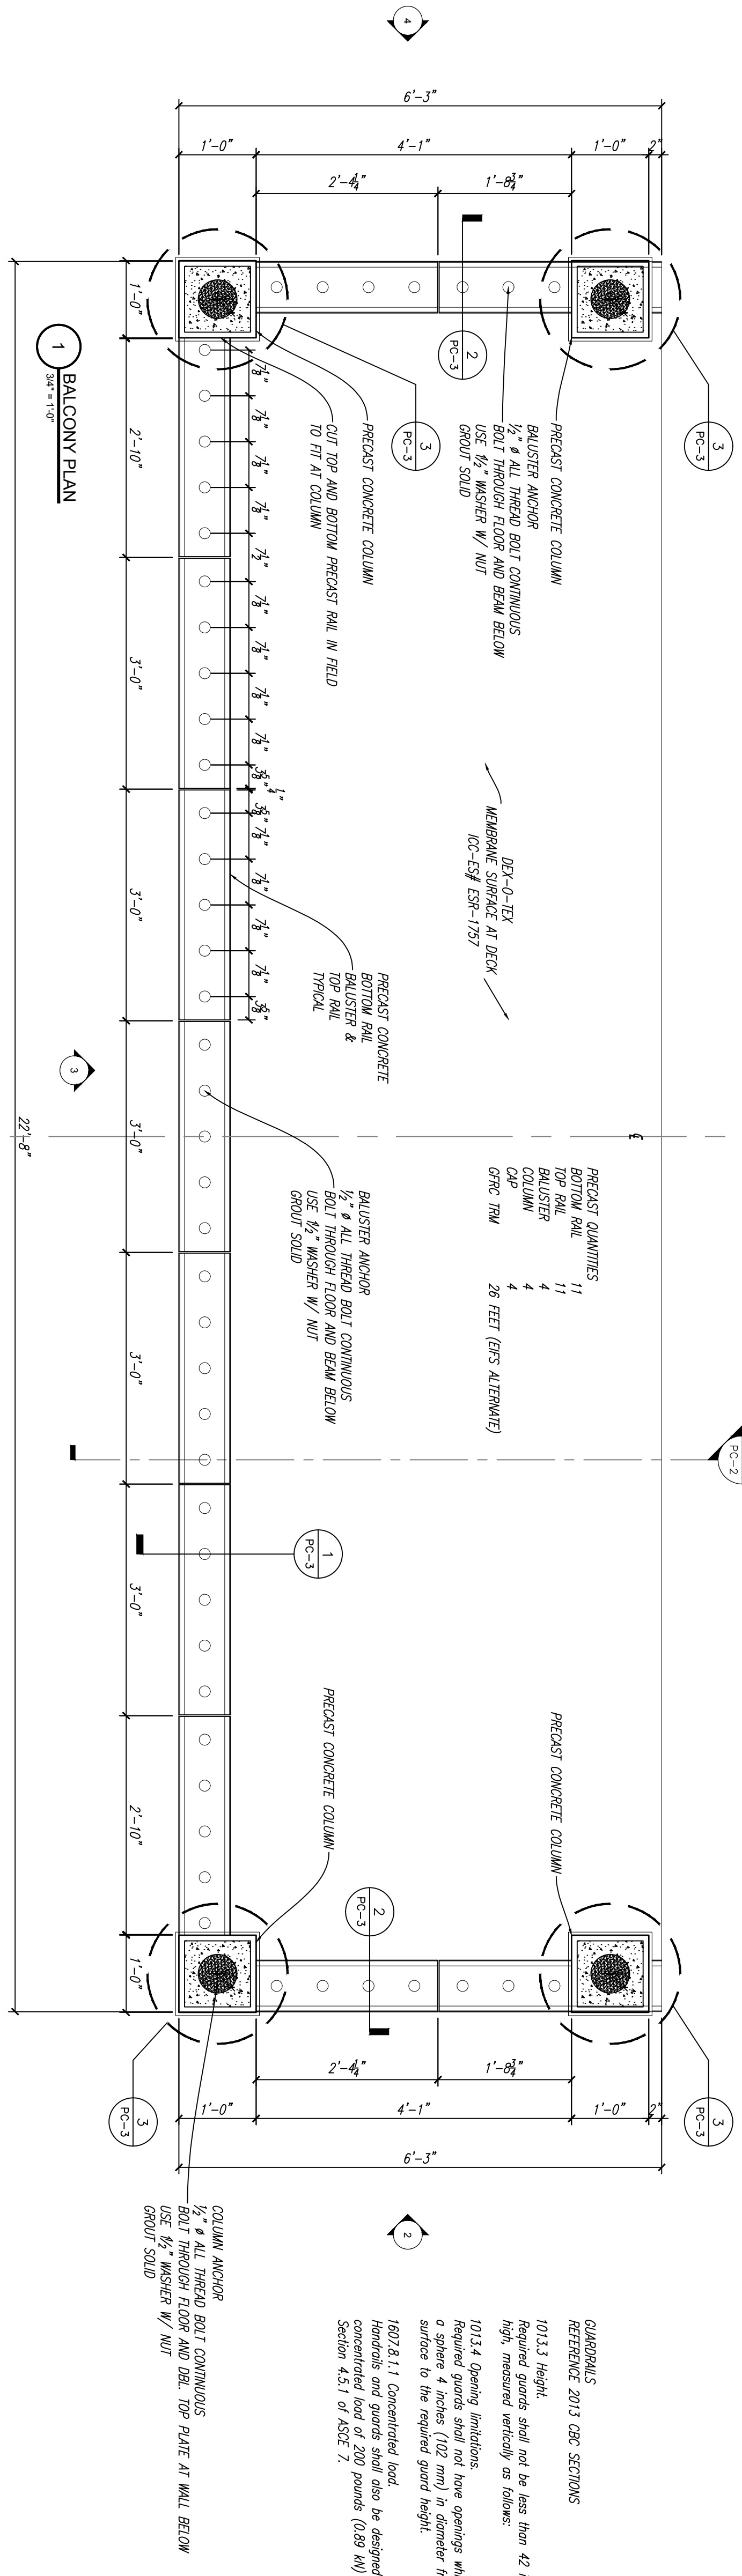


Installation Drawings: Offered for reference only.  
 Ask for installation drawings that are similar to your jobs requirements.

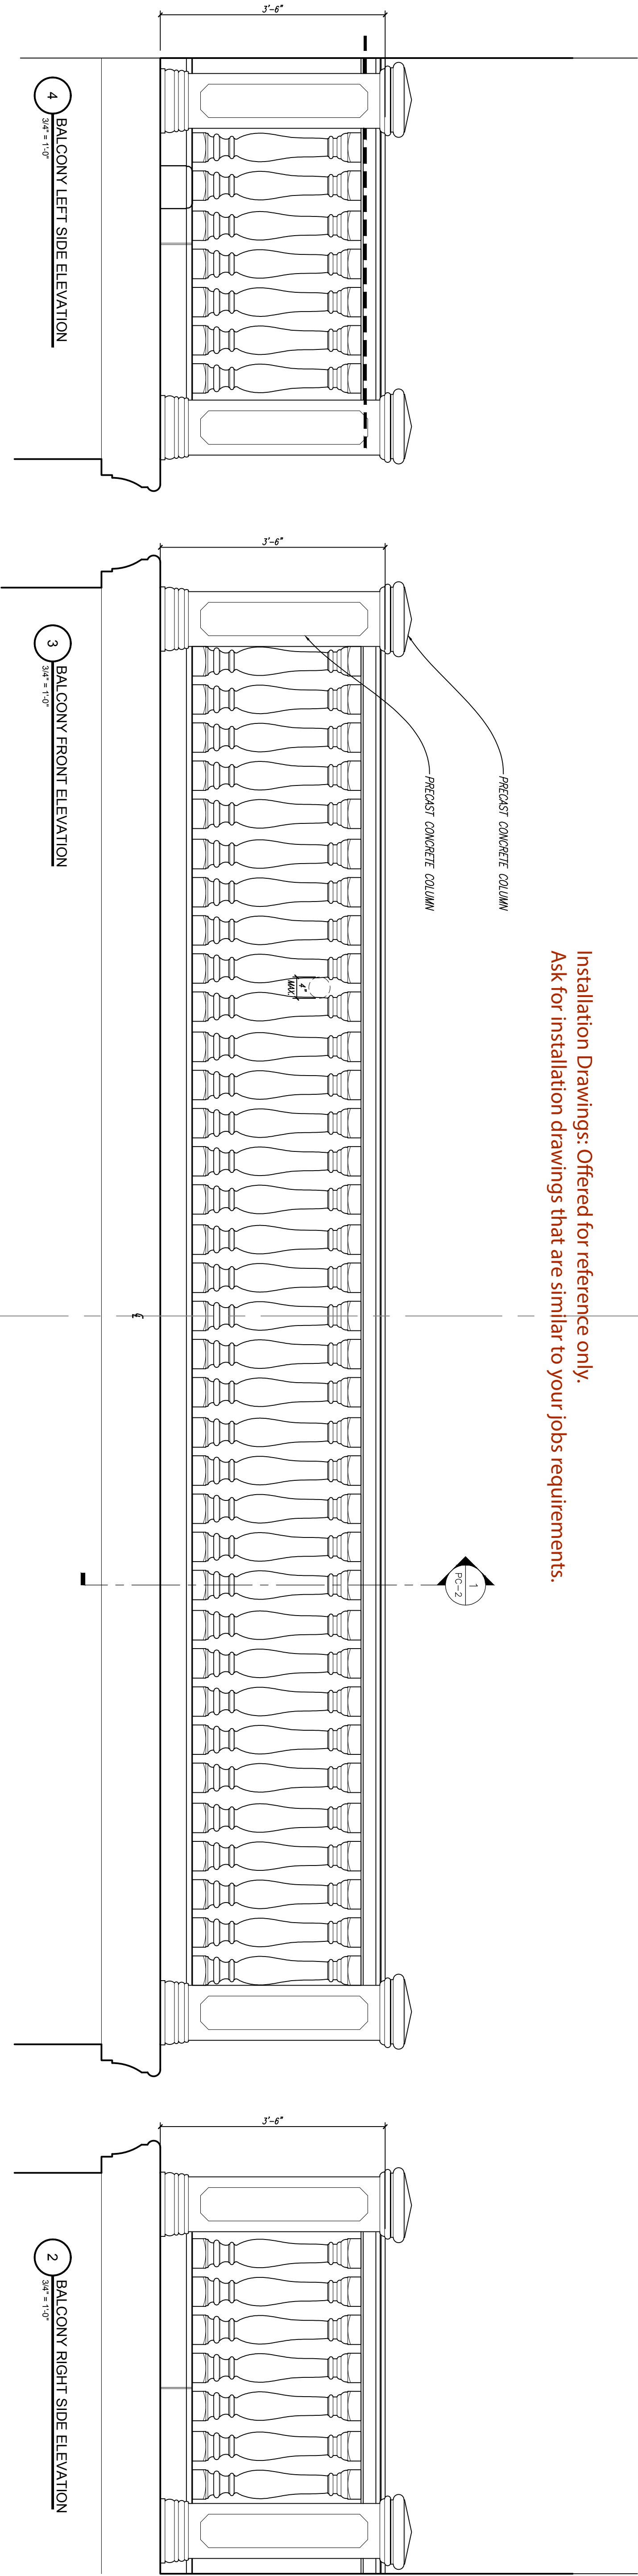

PRECAST QUANTITIES

TOP RAIL	11
BOTTOM RAIL	11
BALUSTER COLUMN	4
PRECAST CONCRETE COLUMN	4
ANCHOR	28 FEET (35% ALTERNATE)

CHANGERS  
 REFERENCE 2013 CBC SECTIONS  
 1013.3 Height  
 Required guards shall not be less than 42 inches (1067 mm) high, measured vertically as follows:  
 1013.4 Opening limitations  
 Required guards shall not have openings which allow passage of a sphere 4 inches (102 mm) in diameter vertically from the walking surface to the required guard height.  
 1607.8.1.1 Concentrated load  
 Handrails and guards shall also be designed to resist a horizontal load of 75 pounds (333 N) in diameter with Section 4.5.1 of ASCE 7.

Installation Drawings: Offered for reference only.  
 Ask for installation drawings that are similar to your jobs requirements.

DESCRIPTION: PLAN & ELEVATIONS			SALES 877 774 3280 TOLL FREE INTERNATIONAL +1.1.949.281.7345 SALES@LAGUNAPRECAST.COM WWW.LAGUNAPRECAST.COM
OWNER:			
PRODUCT / SHEET #:	DATE: Jul 02, 2015 - 2:15pm		
PC-1	SCALE: AS NOTED		
DRAWN BY:	REVISIONS:		